


ALL SERVICE LINES SHALL BE
6" UNLESS NOTED OTHERWISE

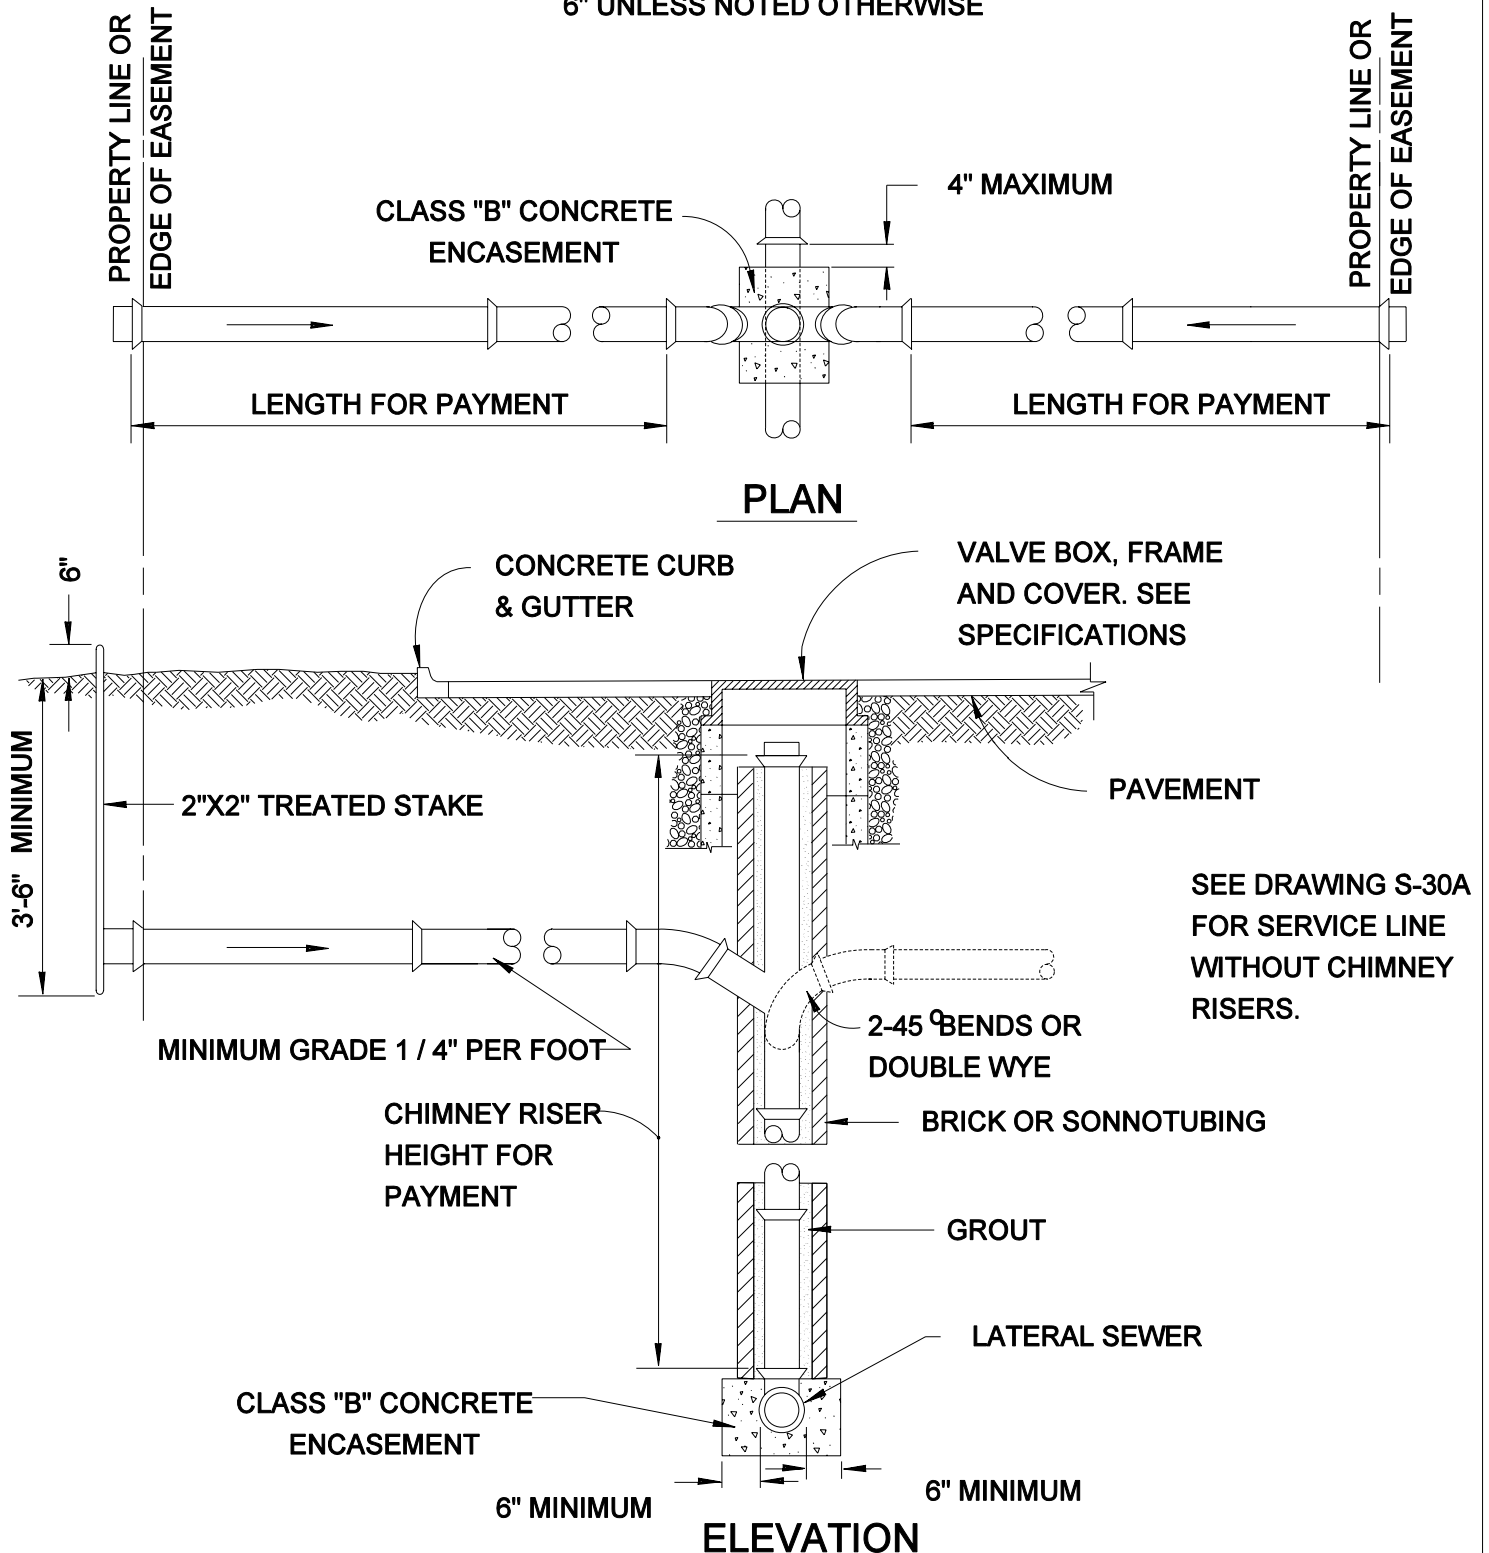

DRAWING NOT TO SCALE

MAY 27, 1994

DRAWN BY: A.H.W.F.
APPROVED BY: K.N.H.

SANITARY SEWER SERVICE LINE

DRAWING 2 OF 2

STANDARD
DRAWING NO.

S - 30B

MURFREESBORO WATER & SEWER DEPARTMENT